akribis

CONFIGURATION FILE DESCRIPTION

CU-LH

Produal

Distributed by AKRIBIS



PRODUAL
measure-be sure.

Application note AN007.1

CU-LH: Standard applicaton

Outputs

AD1: 24 Vac PWM, heating (pulse width is 90 s)
AD2: 24 Vac PWM, cooling (pulse width is 90 s)
AO3: 0...10 V, VAV, CO_2 /T (maximum control)
AO4: 0...10 V, EC fan coil, 3-steps

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs


IN1: NTC 10K, external temperature
IN2: Contact switch (NO), operation mode switch
IN3: 0...10 V, external CO_2 transmitter value

Controller (C1)

Dead zone, day	1.0 °C
Dead zone, night	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Room units

Setpoint center	21.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K

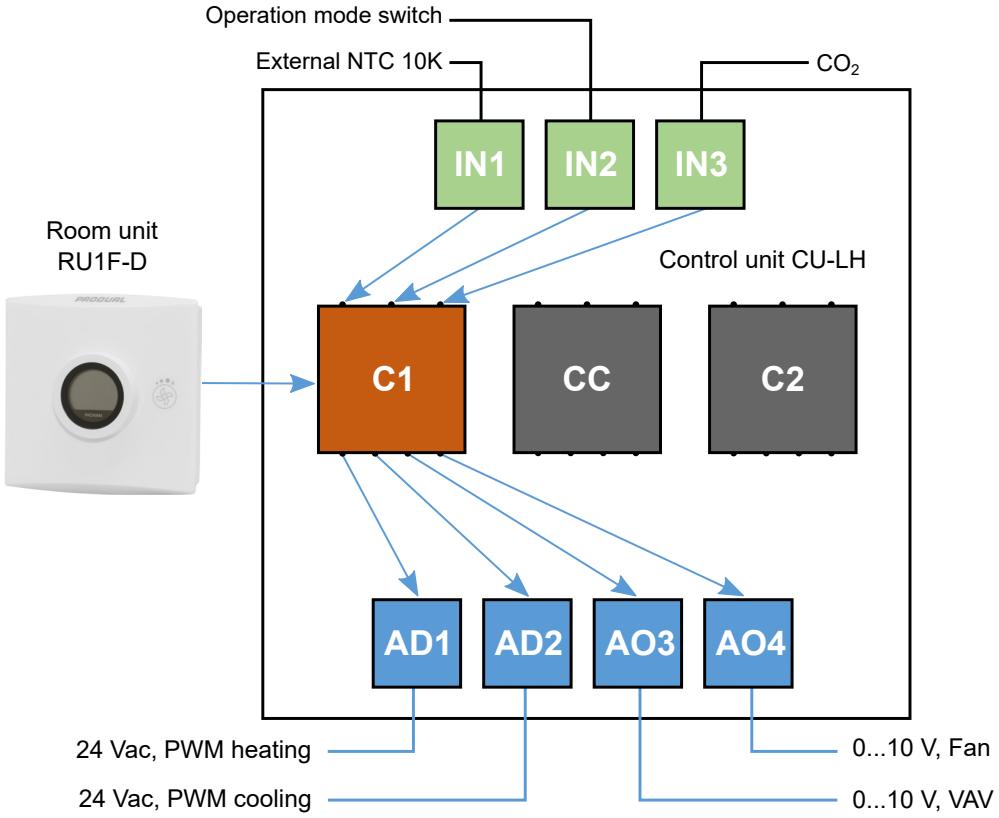

The information provided in this application note is given as hint and example for the use of Produal products and shall not be regarded as any description or warranty of certain functionality, condition, or quality of the Produal product. The recipient of this application note must verify any function described herein in the real application with the support of the technical documentation of the products. Produal hereby disclaims any and all warranties and liabilities of any kind, including without limitation warranties of non-infringement of intellectual property rights of any third party, with respect to any and all information given in this application note.

PRODUAL
measure-be sure.

Application note AN007.2

CU-LH: 6-way valve control

Outputs

AD1: 0...10 V, 0...4.7 V cooling, 7.3...10 V heating
AD2: 0...10 V, 0...4.7 V heating, 7.3...10 V cooling
AO3: 0...10 V, VAV
AO4: 0...10 V, fan coil

Inputs


IN1: NTC 10K, external temperature
IN2: Contact switch (NO), operation mode switch
IN3: 0...10 V, external CO_2 transmitter value

Controller (C1)

Dead zone, day	1.0 °C
Dead zone, night	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Room units

Setpoint center	21.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K

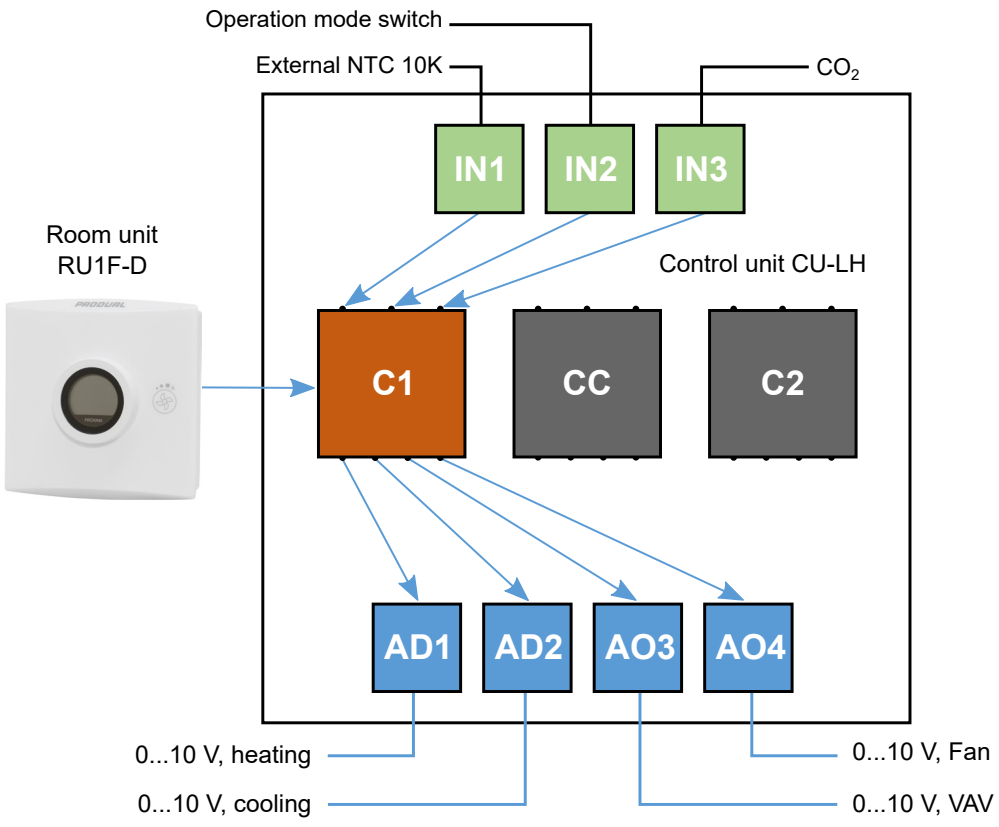

AKRIBIS www.akribis.info contacto@akribis.info

Application note AN007.3

CU-LH: 3-point heating actuator control, 0...10 V cooling and VAV

Outputs

AD1: 24 Vac, heating, 3-point raise (+), runtime 180 s
AD2: 24 Vac, heating, 3-point lower (-)
AO3: 0...10 V, cooling
AO4: 0...10 V, VAV, CO_2 / T (maximum control)

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Change AD1 to cooling and AO3 to heating if cooling and heating needs to be swapped (requires Produal MyTool® Android application and MyTool Connect Bluetooth dongle, or BMS communication)

Inputs


IN1: NTC 10K, external temperature
IN2: Contact switch (NO), operation mode switch
IN3: 0...10 V, external CO_2 transmitter value

Controller (C1)

Dead zone, day	1.0 °C
Dead zone, night	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Room units

Setpoint center	21.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K

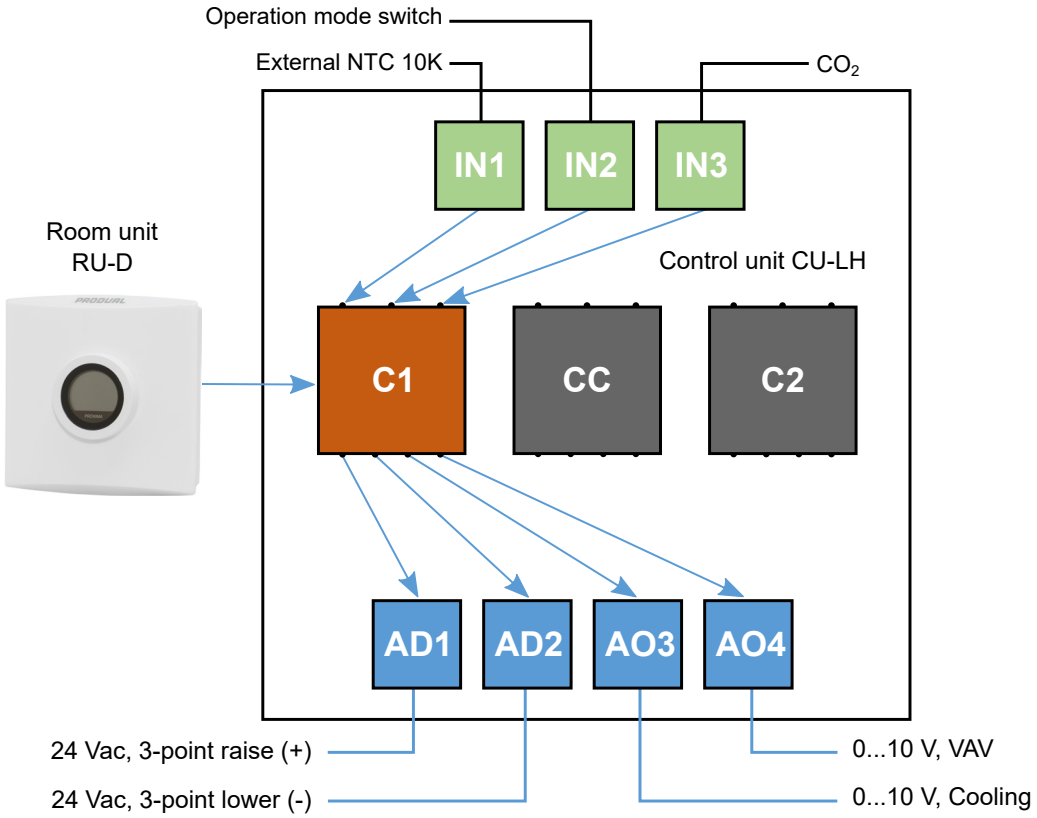

PRODUAL
measure-be sure.

Application note AN007.4

CU-LH: Hotel room with cooling, heating, fan control and VAV

Outputs

AD1: 24 Vac PWM, heating (pulse width is 90 s)
AD2: 24 Vac PWM, cooling (pulse width is 90 s)
AO3: 0...10 V, VAV, CO_2 /T / RH% (maximum control)
AO4: 0...10 V, EC fan coil, 3-steps

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs

IN1: NTC 10K, external temperature
IN2: Contact switch (NO), operation mode switch
40 minutes off timer from day mode to night mode
IN3: 0...10 V, external CO_2 transmitter value
CO_2 signal will open VAV between 700...1200 ppm


Controller (C1)

Dead zone, day (guest in)	0.5 °C
Dead zone, night (guest out)	1.0 °C
Dead zone, eco (checked out)	2.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Eco mode (unbooked) must be set from BMS, since IN2 switches between day and night modes. When entering eco mode, the setpoint is set to 22.0°C

Room units

Setpoint center	22.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K

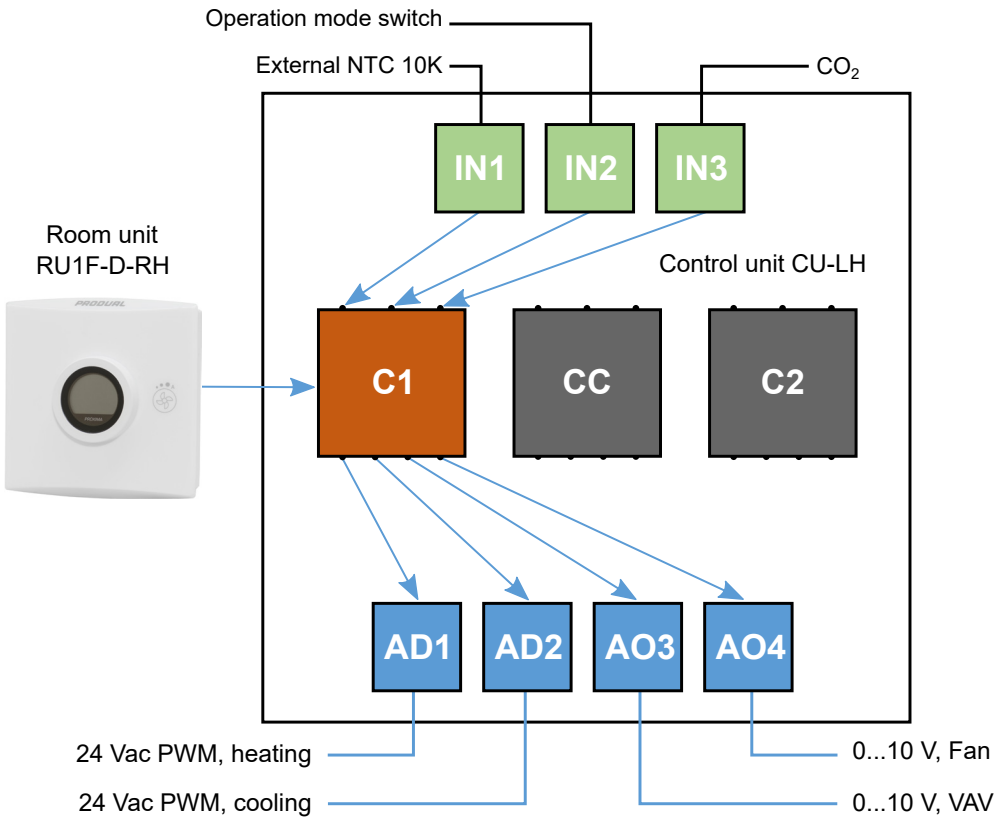

AKRIBIS www.akribis.info contacto@akribis.info

Application note AN007.5

CU-LH: Cooling, heating, VAV control, room unit with CO_2

Outputs

AD1: 24 Vac PWM, heating (pulse width is 90 s)
AD2: 24 Vac PWM, cooling (pulse width is 90 s)
AO3: 0...10 V, VAV, CO_2 /T (maximum control)

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs


IN1: NTC 10K, for external temperature
IN2: Contact switch (NO), operation mode switch

Controller (C1)

Dead zone, day	1.0 °C
Dead zone, night	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Room units

Setpoint center	21.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K
CO_2 range	700...1200 ppm

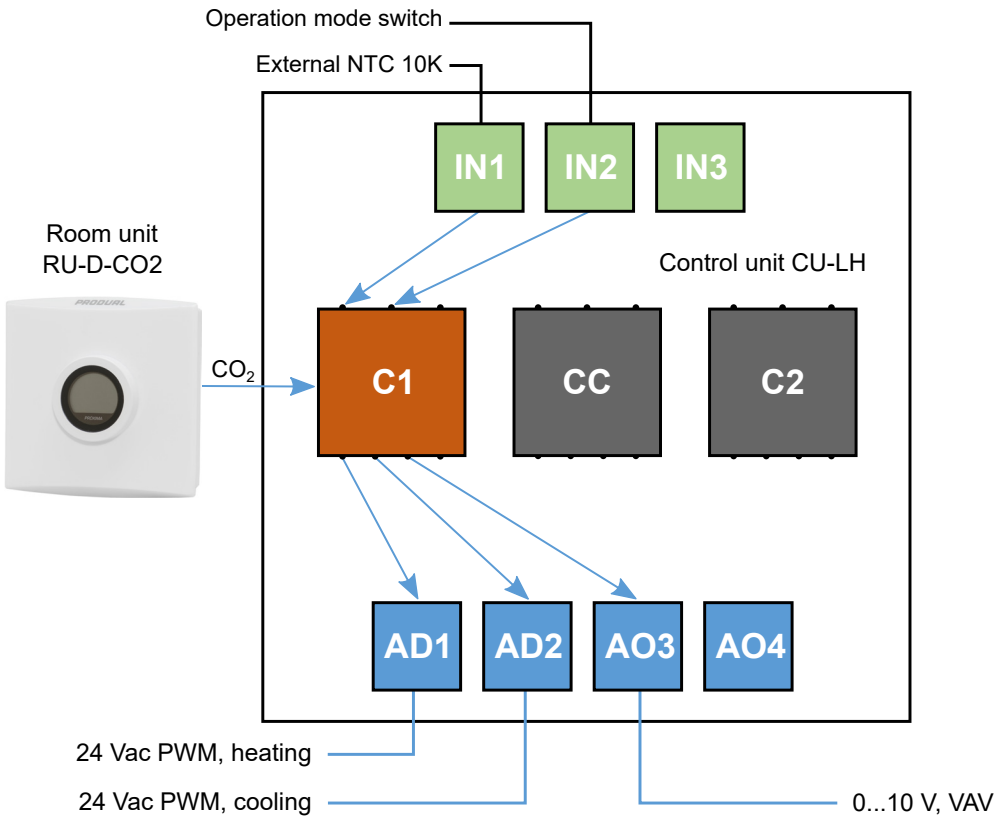

PRODUAL
measure-be sure.

Application note AN007.6

CU-LH: VAV control with external CO_2, temperature and setpoint

Outputs

AD1: 24 Vac PWM, heating (pulse width is 90 s)
AD2: 24 Vac PWM, cooling 1 (pulse width is 90 s)
AO3: 0...10 V, cooling 2 and VAV, CO_2 /T (maximum control)

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs


IN1: 0...10 V, CO_2, 0...2000 ppm, 700...1200 ppm control range
IN2: 0...10 V, temperature, 0...50 °C
IN3: 0...10 V, setpoint, 19...25 °C

Controller (C1)

Dead zone, day	1.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s
Setpoint source	IN3
Temperature source	IN2

Cooling sequence

- VAV open on 0...50 % cooling demand or 0...10 V on 700...1200 ppm
- AD2 open on 50...100 % cooling demand

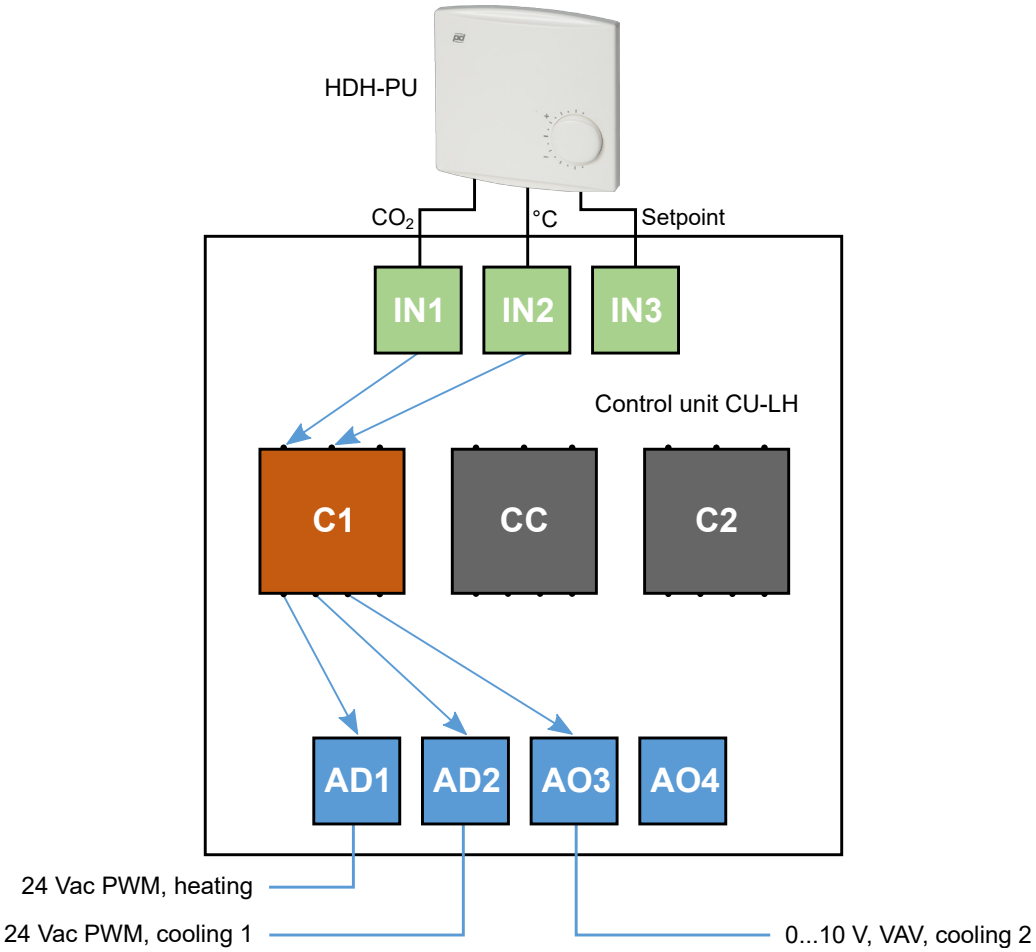

AKRIBIS www.akribis.info contacto@akribis.info

Application note AN007.7

CU-LH: 2 rooms with heating, combined VAV and cooling

Outputs

AD1: 24 Vac PWM, heating room 1 (pulse width is 90 s)
AD2: 24 Vac PWM, heating room 2 (pulse width is 90 s)
AO3: 0...10 V, VAV / cooling room 1, CO_2 / T (maximum control)
AO4: 0...10 V, VAV / cooling room 2, CO_2 / T (maximum control)

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs


IN1: Contact switch (NO), operation mode switch, room 1
IN2: Contact switch (NO), operation mode switch, room 2

Controller (C1)

Dead zone, day	1.0 °C
Dead zone, night	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Room units

Setpoint center	21.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K
CO_2 range	700...1200 ppm

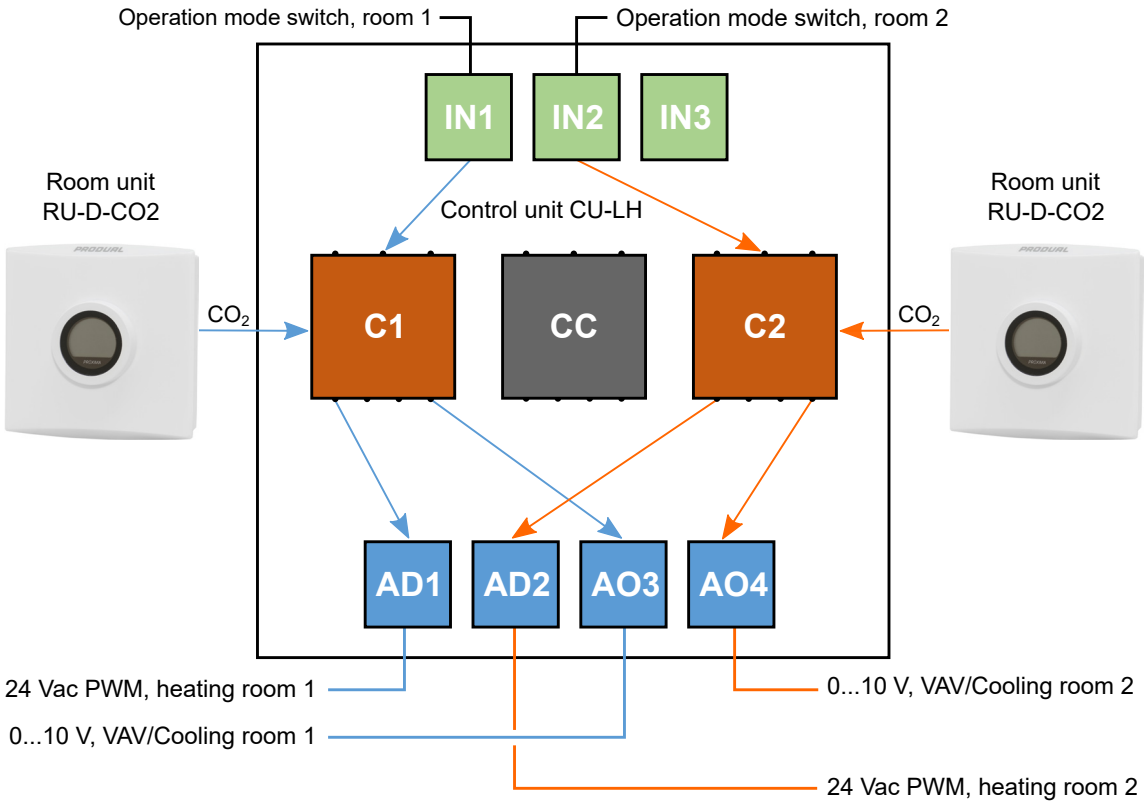

PRODUAL
measure-be sure.

Application note AN007.8

CU-LH: Heating, cooling and fan coil 0...10 V for cooling

Outputs

AD1: 24 Vac PWM, heating (pulse width is 90 s)
AD2: 24 Vac PWM, cooling (pulse width is 90 s)
AO3: 0...10 V, EC fan coil, 3-steps

AD1 and AD2 are controlled with G0. Actuator must be connected between G and the output AD1 or AD2.

Inputs

IN1: Resistive condensation sensor (or relay pulling to G0 at condensation). Blocks the cooling at condensation.
IN2: Contact switch (NO), operation mode switch (night/day). If the switch is not connected, operation mode is day.


Controller (C1)

Dead zone, day (guest in)	0.5 °C
Dead zone, night (guest out)	1.0 °C
Dead zone, eco (checked out)	3.0 °C
P-band, heating	1.5 °C
P-band, cooling	1.5 °C
Integral time	160 s

Eco mode (unbooked) must be set from BMS, since IN2 switches between day and night modes. When entering eco mode, the setpoint is set to 22.0°C

Room units

Setpoint center	22.0 °C
Setpoint steps	0.5 °C
Setpoint range	±3.0 K

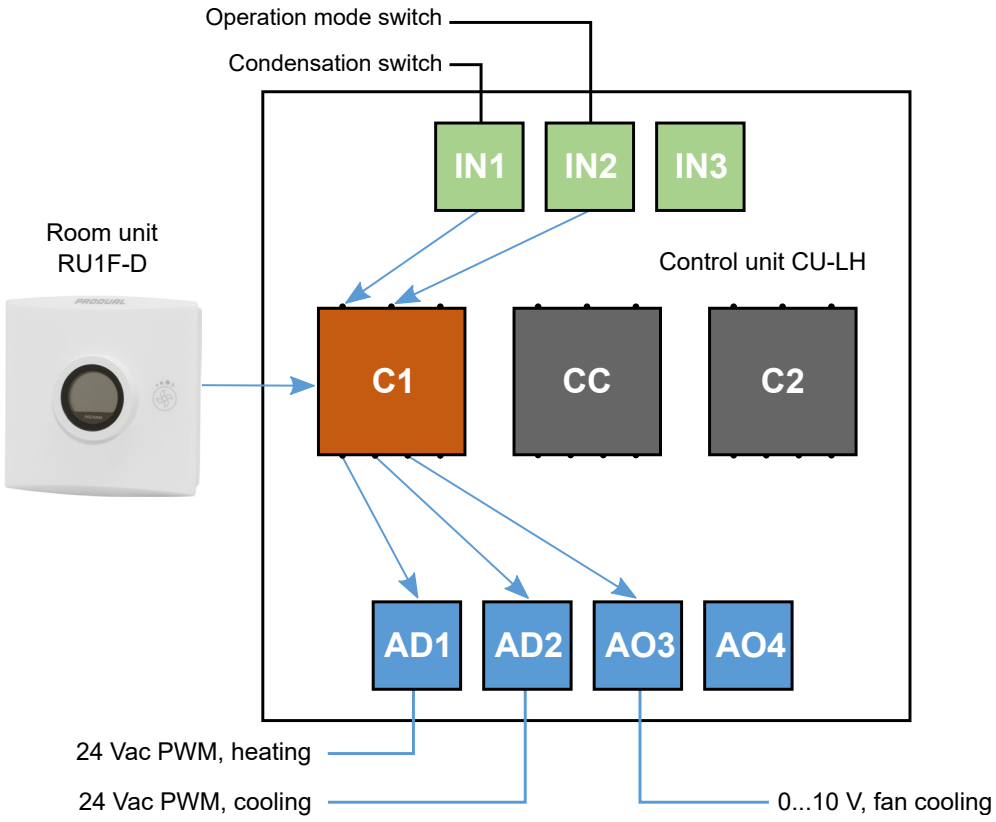

AKRIBIS www.akribis.info contacto@akribis.info